


Steelmill Bremen

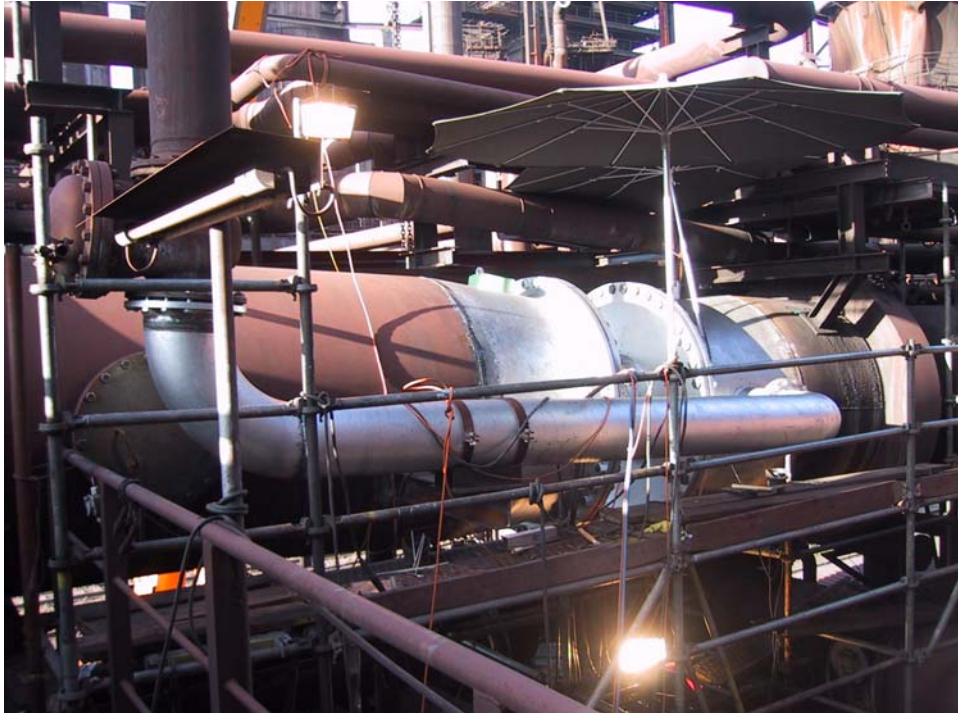

Project description: Modification of a cooling air supply pipe DN 1800 at blast furnace 2

Scope of work: Supply, dismantling and installation of a check valve DN 1600 including re-routing of an emergency air supply line DN 400 and related steel works.

Contractor: PPS, WINTER ROHRBAU,
Phone +49 5431 14-0, Fax +49 5431 14-260

Client: arcelor, Stahlwerke Bremen